


NOTES:  
 ALL INTERNAL WIRING 7/0.4mm UNLESS OTHERWISE SHOWN  
 # SWITCH LOCATED ON SIDE OF LOCATION  
 #1 LOW CURRENT FAULT SET TO 1A  
 #2 DIODE MOUNTED DIRECTLY BEHIND RELAY

| VOLTAGE SETTINGS          | FOR 12 CELLS | FOR 10 CELLS |
|---------------------------|--------------|--------------|
| CHARGING VOLTAGE          | 17.4V        | 14.5V        |
| LOW VOLTAGE ALARM SETTING | 14.64V       | 12.2V        |

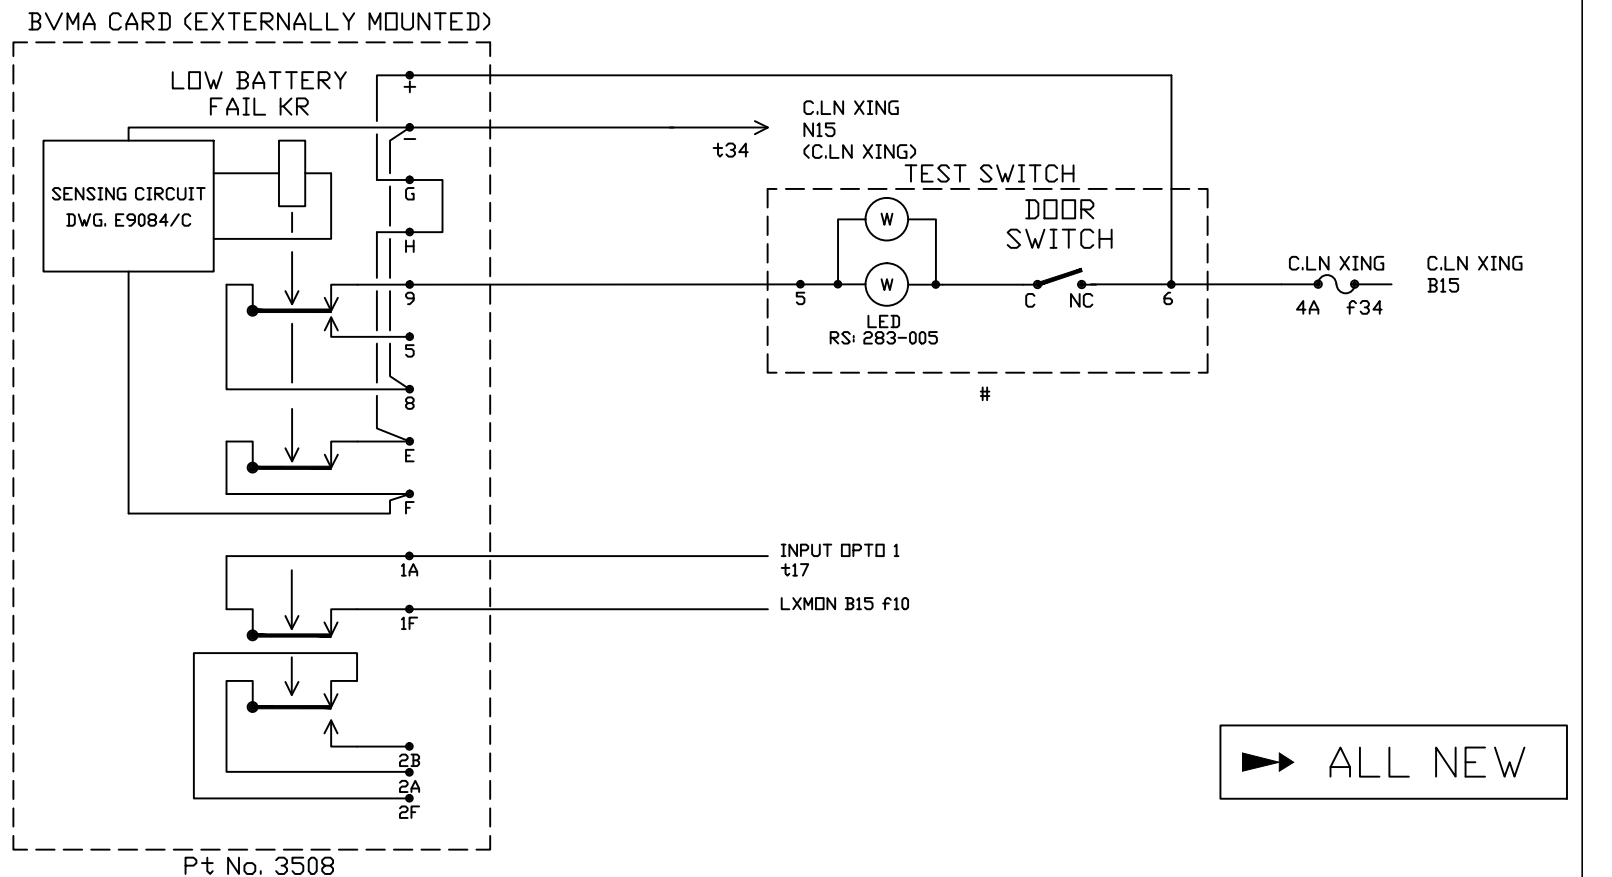

▶▶ ALL NEW